

ROOF REPLACEMENT

H. TEMPLE SPEARS

1515 CYPRESS STREET
LOUISVILLE, KY 40210
LMHA PROPOSAL : 1533

VICINITY MAP




PROJECT LOCATION

SHEET INDEX


CP	COVER PAGE
A0.1	ROOF PLAN
A8.1	ROOF DETAILS
ME1.1	MECHANICAL & ELECTRICAL PLAN

ROOF REPLACEMENT
H. TEMPLE SPEARS
1515 CYPRESS STREET
LOUISVILLE, KY 40210

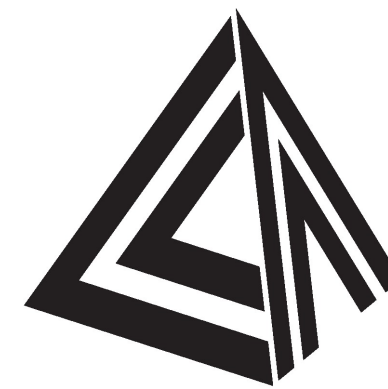

LUCKETT & ASSOCIATES
ARCHITECTS AND ENGINEERS
153 THIERMAN LANE,
LOUISVILLE, KENTUCKY
40207-5000
502-584-6048; (FAX) 502-893-0154
Architect@Lockett.US

DRAWN BY / CHECKED BY	PP / JR
DATE	11/4/20
PROJECT NUMBER	18009
REVISED	
SHEET TITLE	COVER PAGE
DRAWING NUMBER	CP

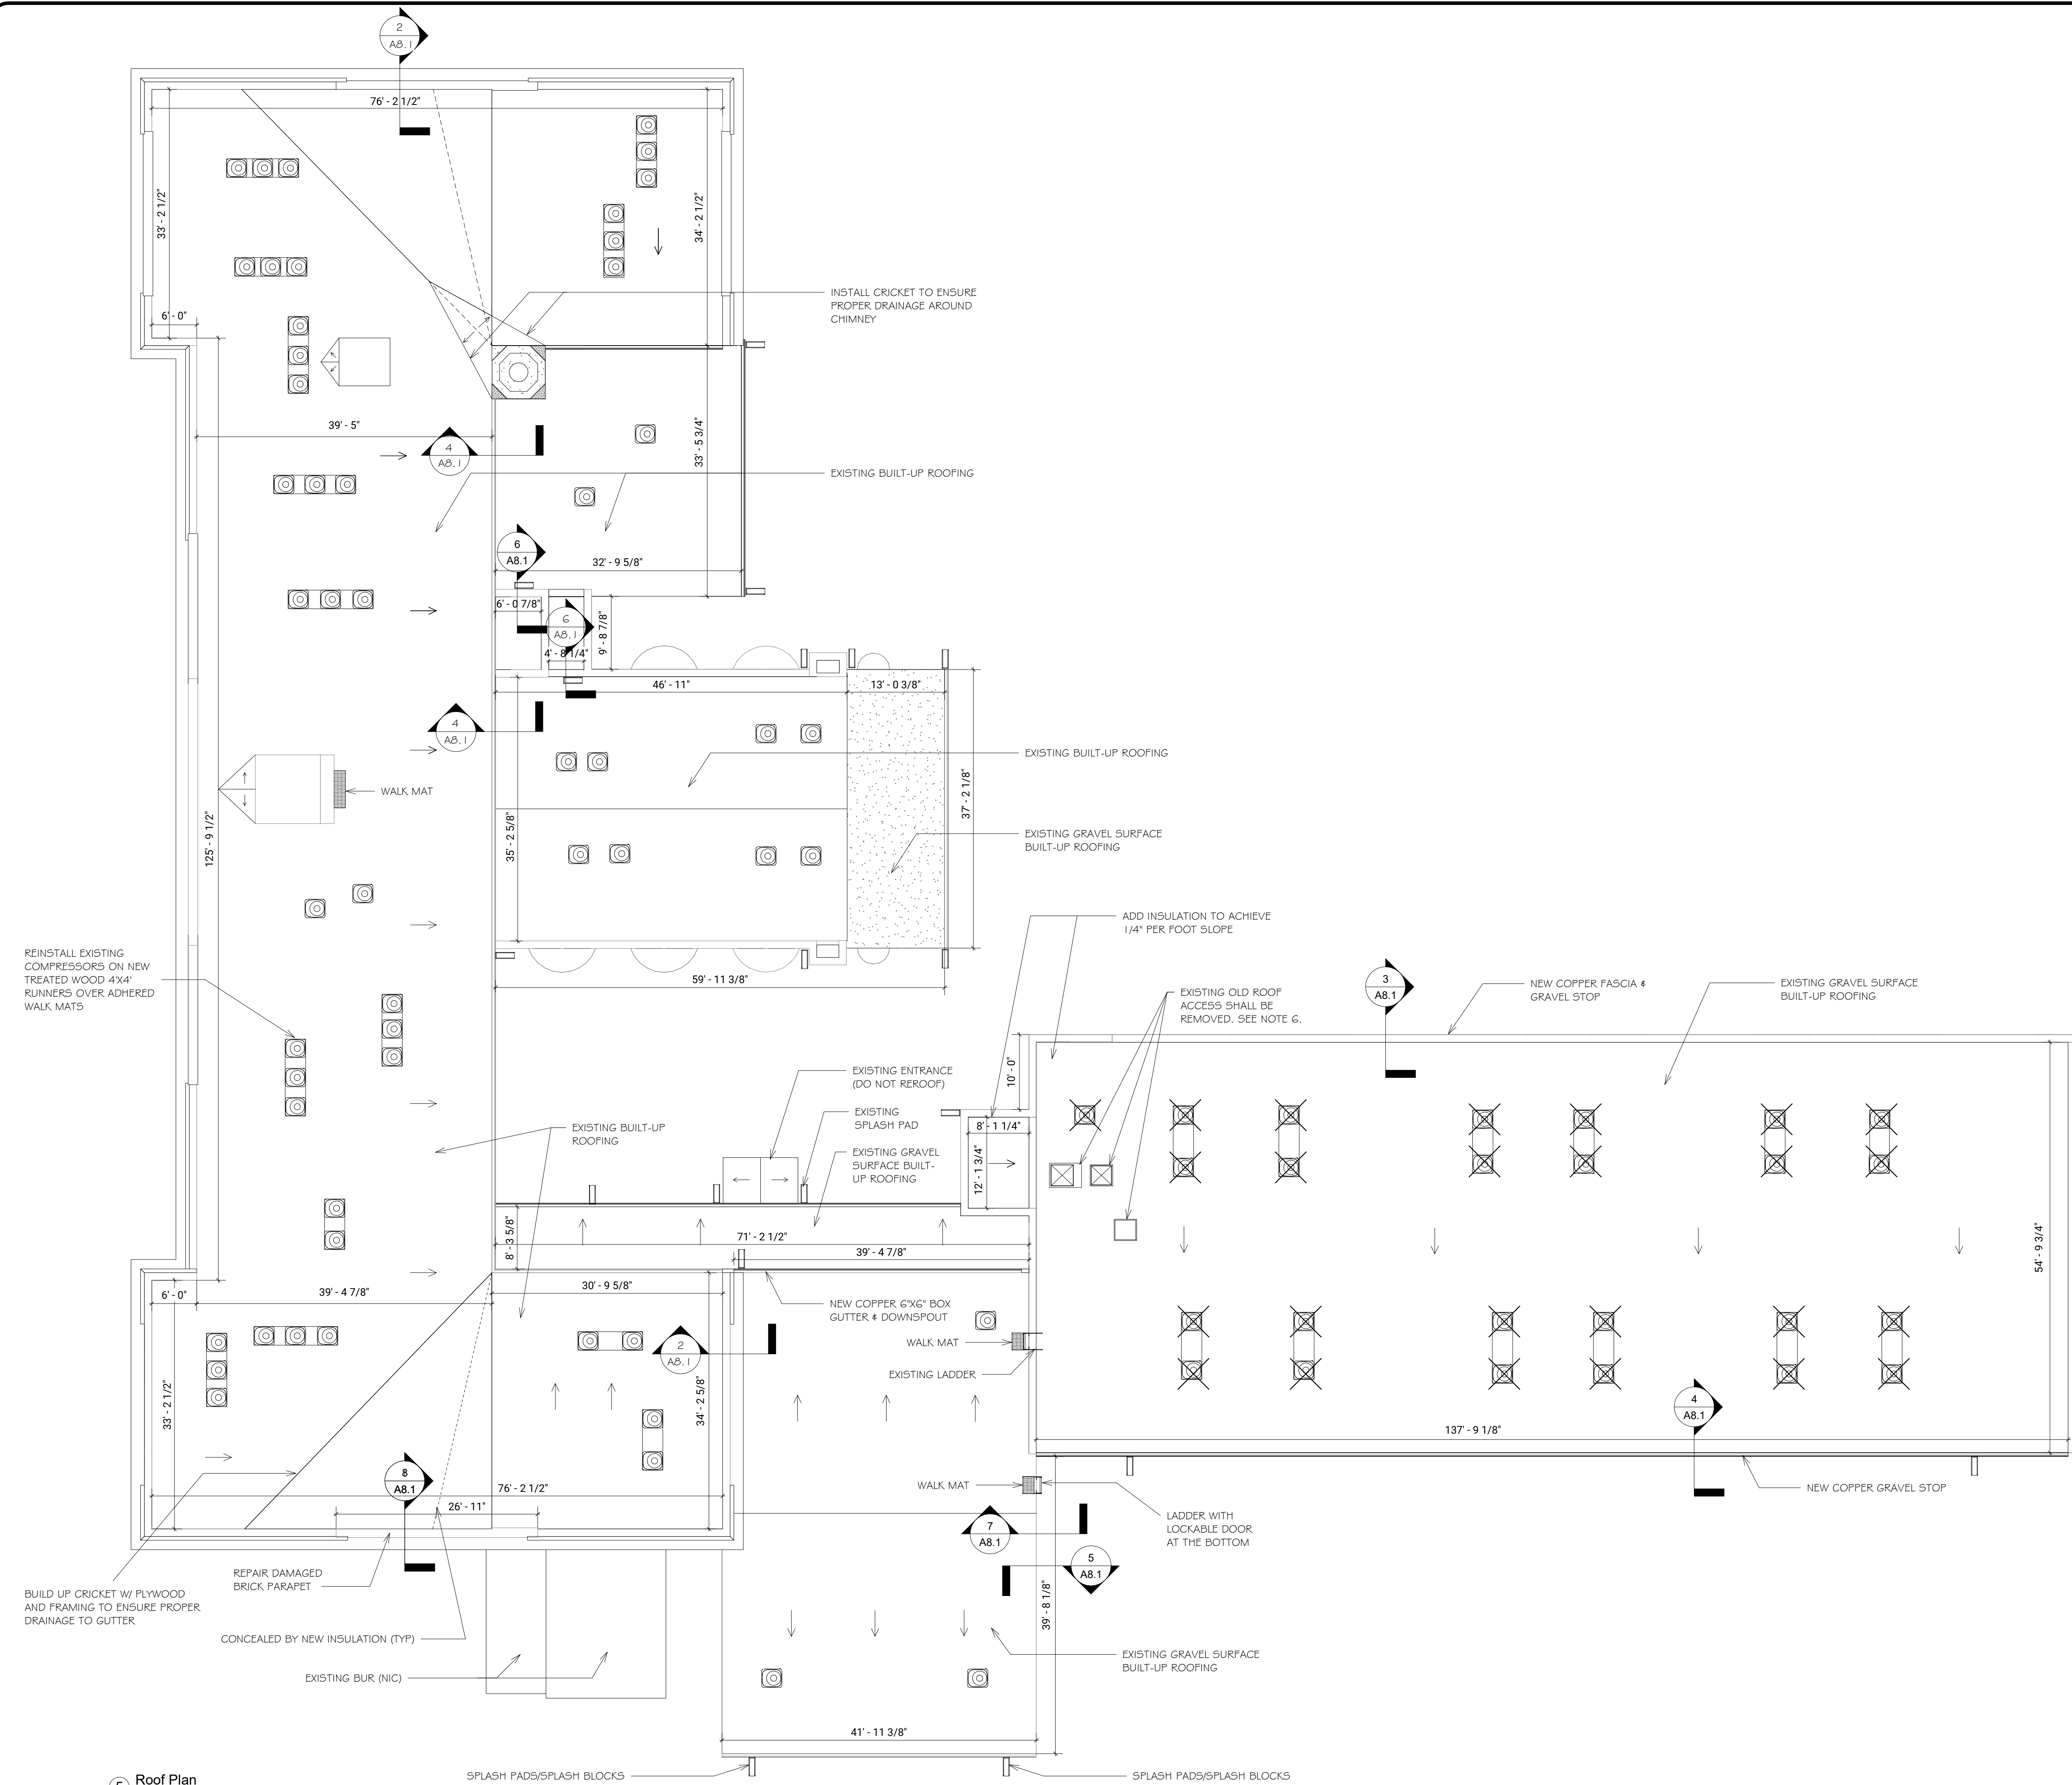


- ROOFING GENERAL NOTES:
1. PROTECT INTERIOR CONTENTS FROM DAMAGE RESULTING FROM ROOFING OPERATIONS.
 2. SPUD GRAVEL FROM EXISTING GRAVEL SURFACED BUR.
 3. PROTECT ROOFING FROM WATER DAMAGE AT THE END OF EACH WORK DAY.
 4. REMOVE DEBRIS DAILY FROM ROOF AND SITE.
 5. GABLE SLOPED, SHINGLED ROOF IS NOT IN CONTRACT. PROTECT FROM DAMAGE AND LEAKAGE DURING AREAS OF ADJACENT ROOFING WORK.
 6. REMOVE EXISTING ROOF ACCESS AND CURBS ON TWO STORY ADDITION. PROVIDE 2x4 FRAMING AND PLYWOOD CLOSURE FLUSH WITH ADJACENT ROOF STRUCTURE BELOW NEW ROOFING AND INSULATION.


DRAWN BY / CHECKED BY	PP / JR
DATE	11/4/20
PROJECT NUMBER	18009
REVISED	
SHEET TITLE	ROOF PLAN
DRAWING NUMBER	A0.1

5 Roof Plan
 3/32" = 1'-0"




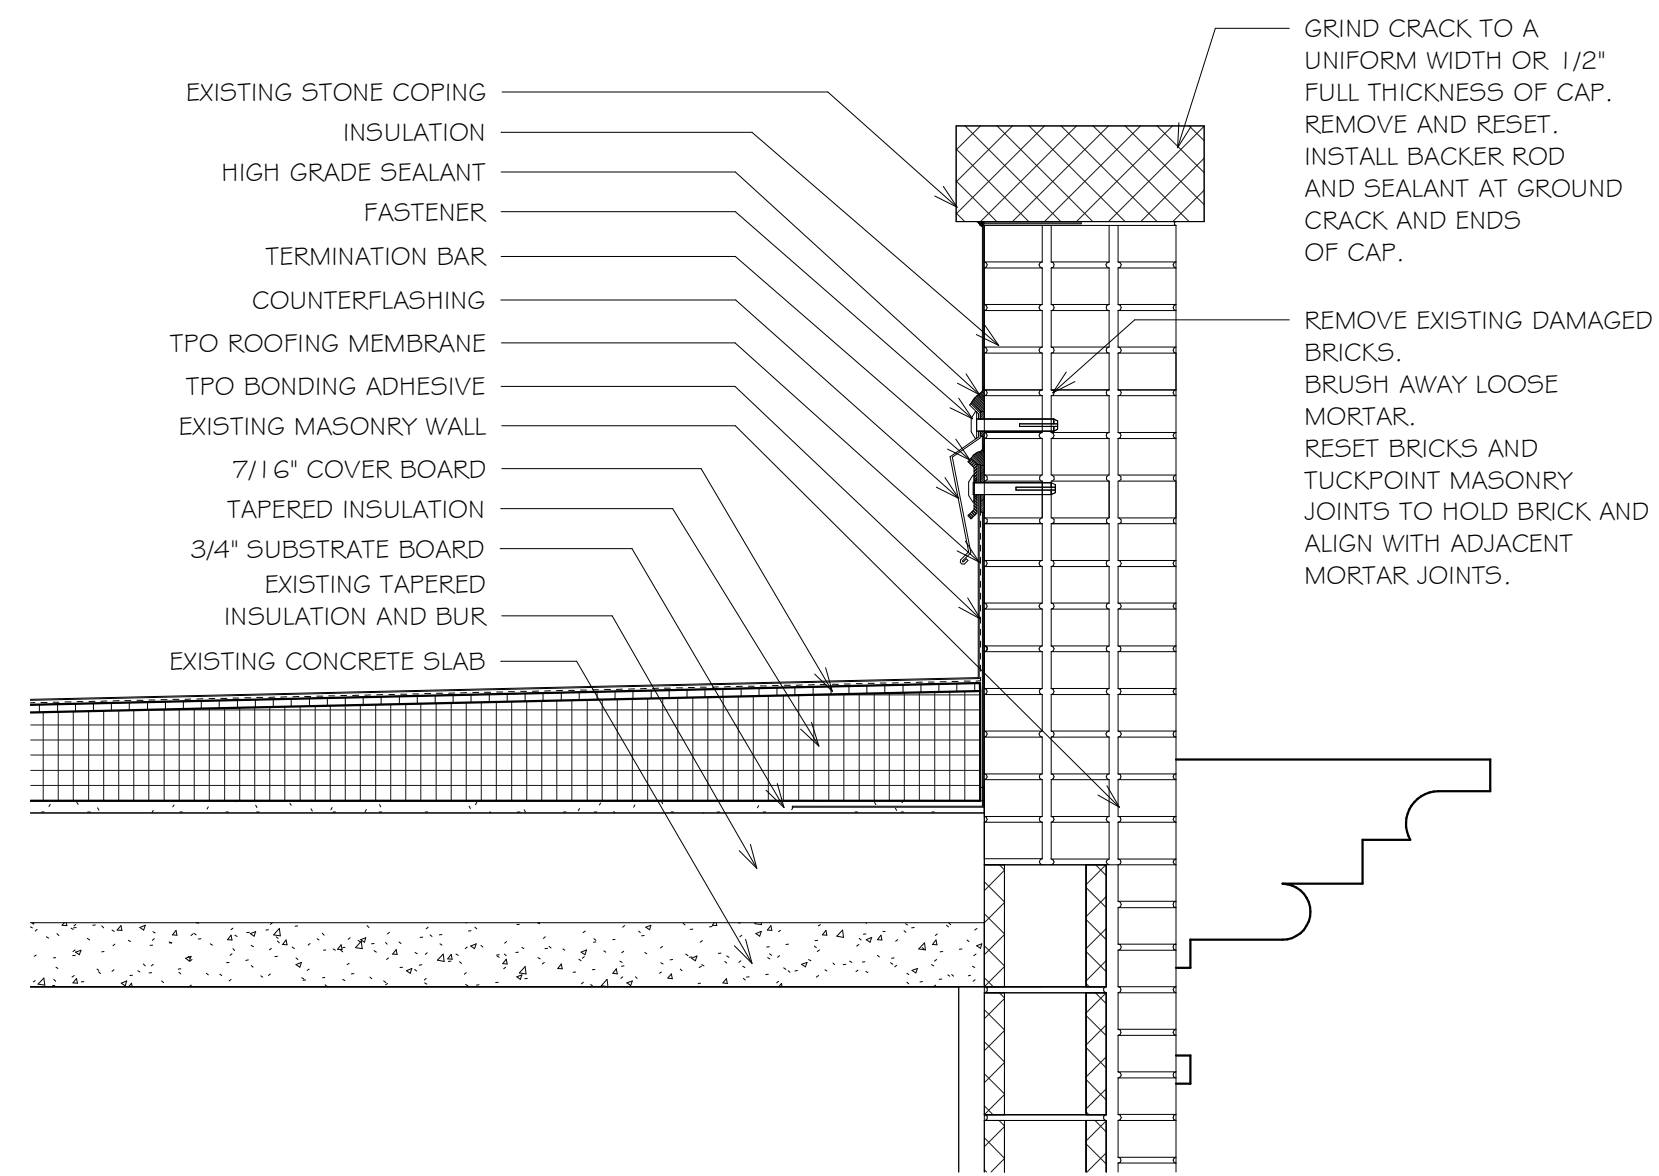


1 PARAPET DETAIL
1" = 1'-0"

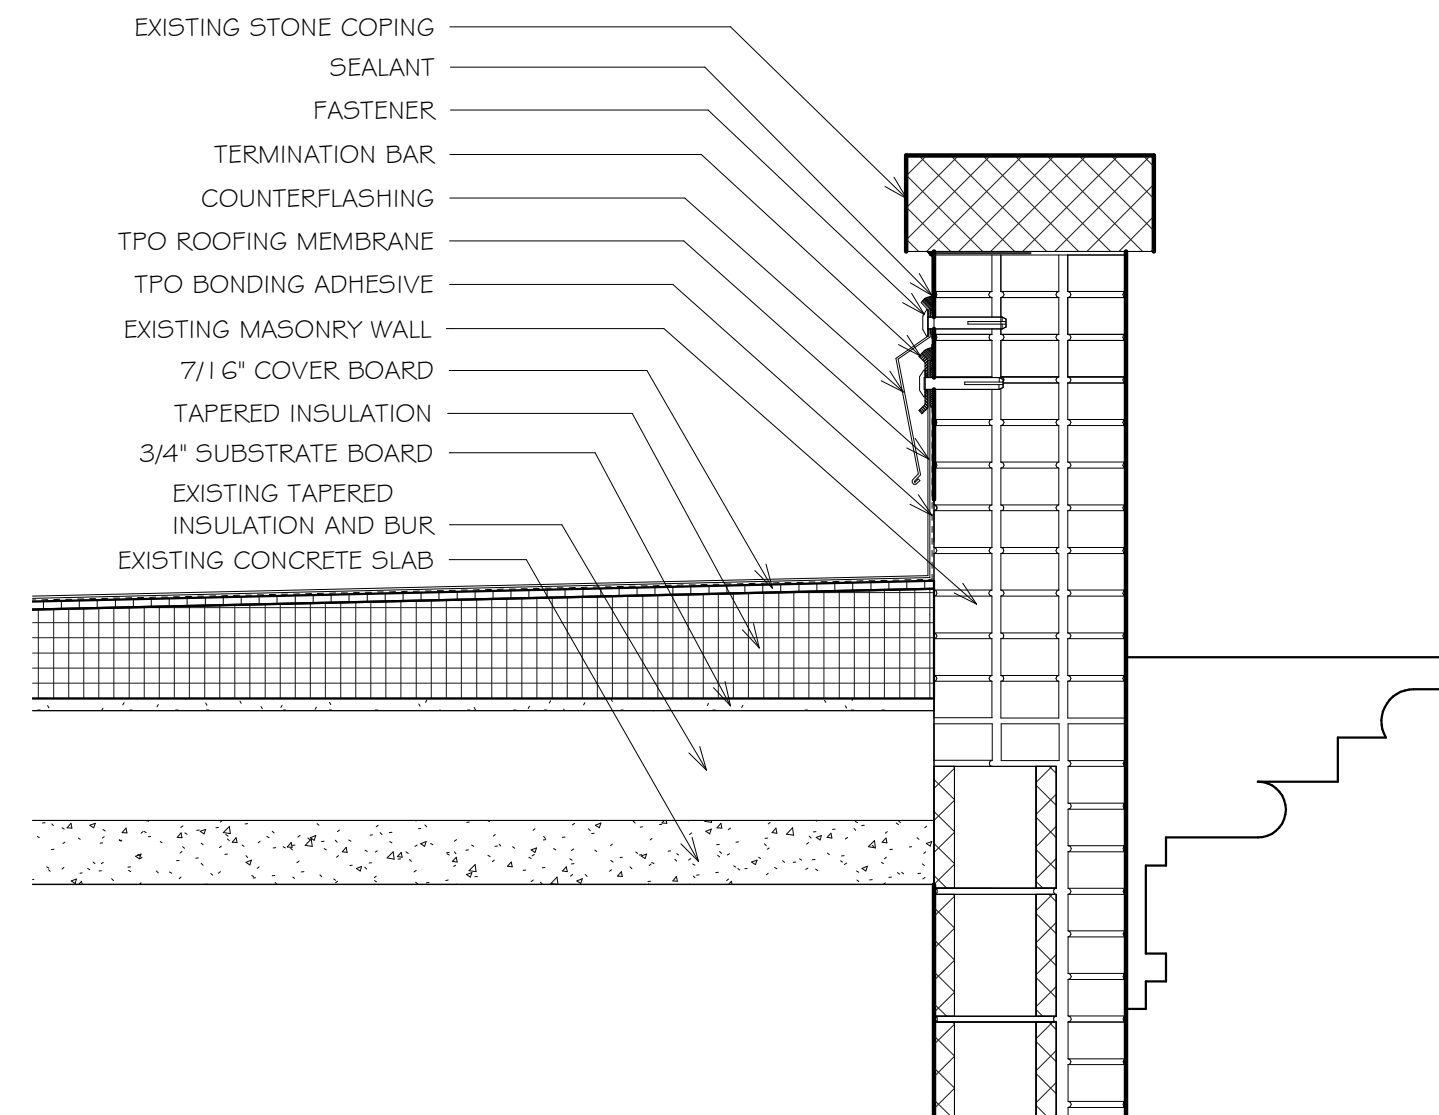


2 PARAPET DETAIL
1" = 1'-0"

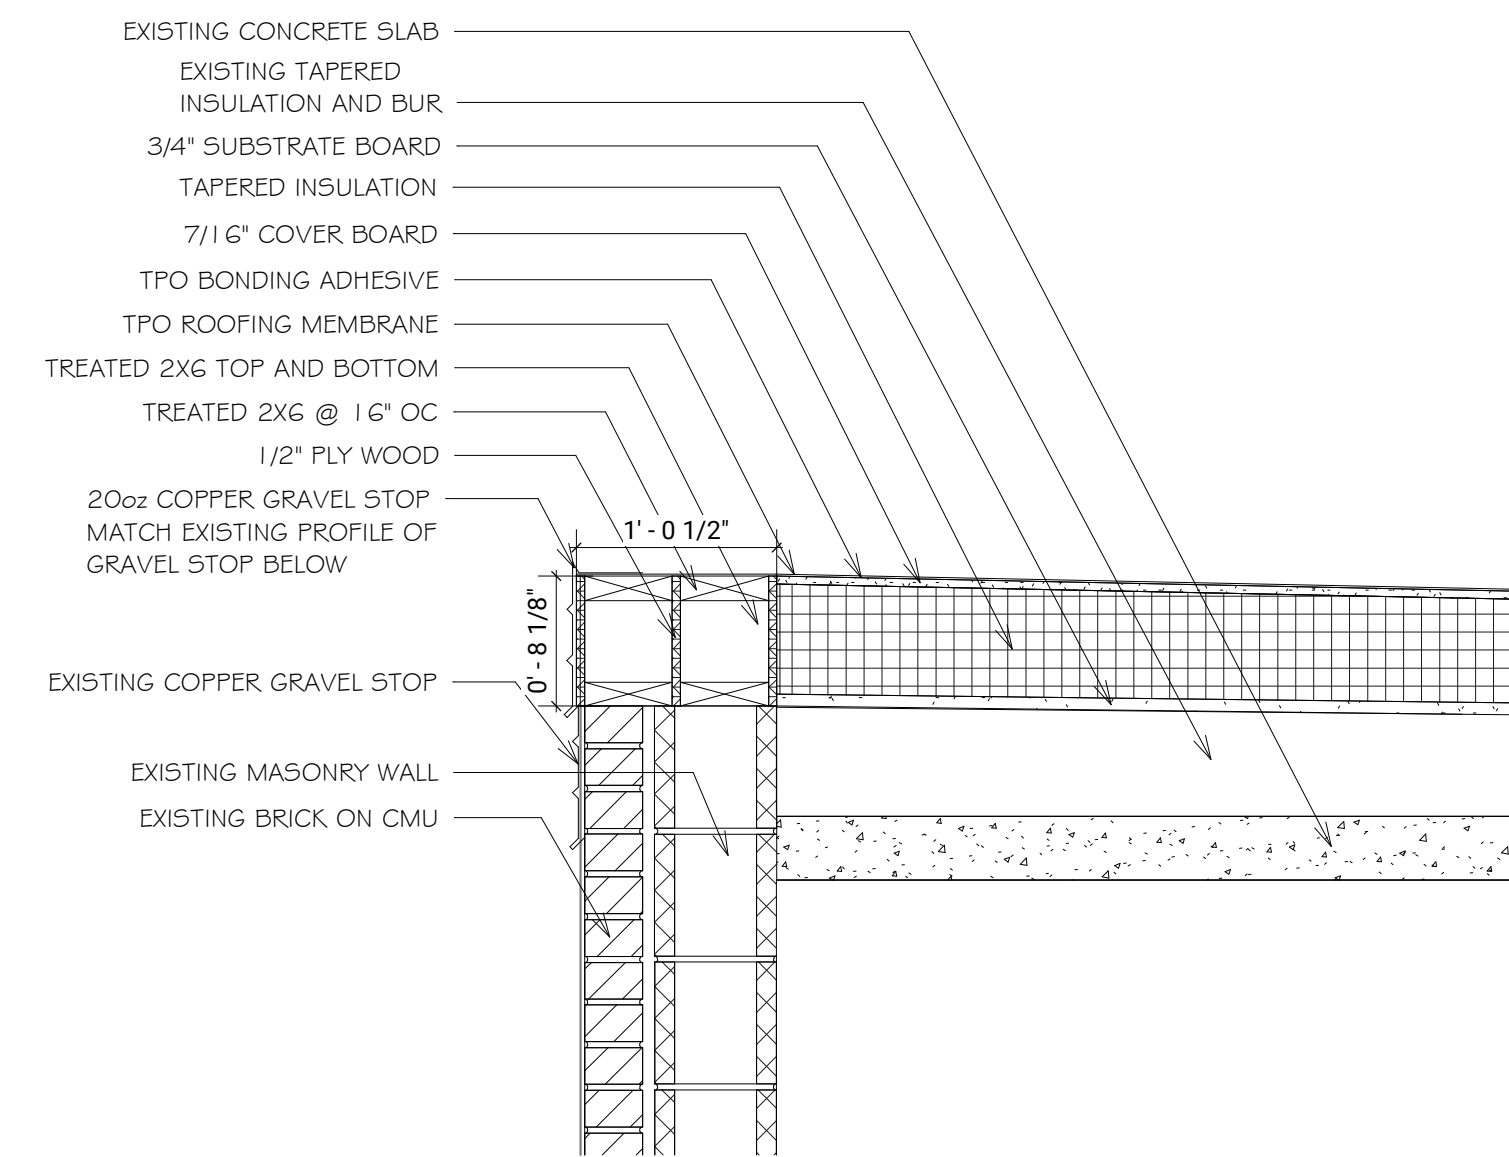


3 EDGE DETAIL
1" = 1'-0"

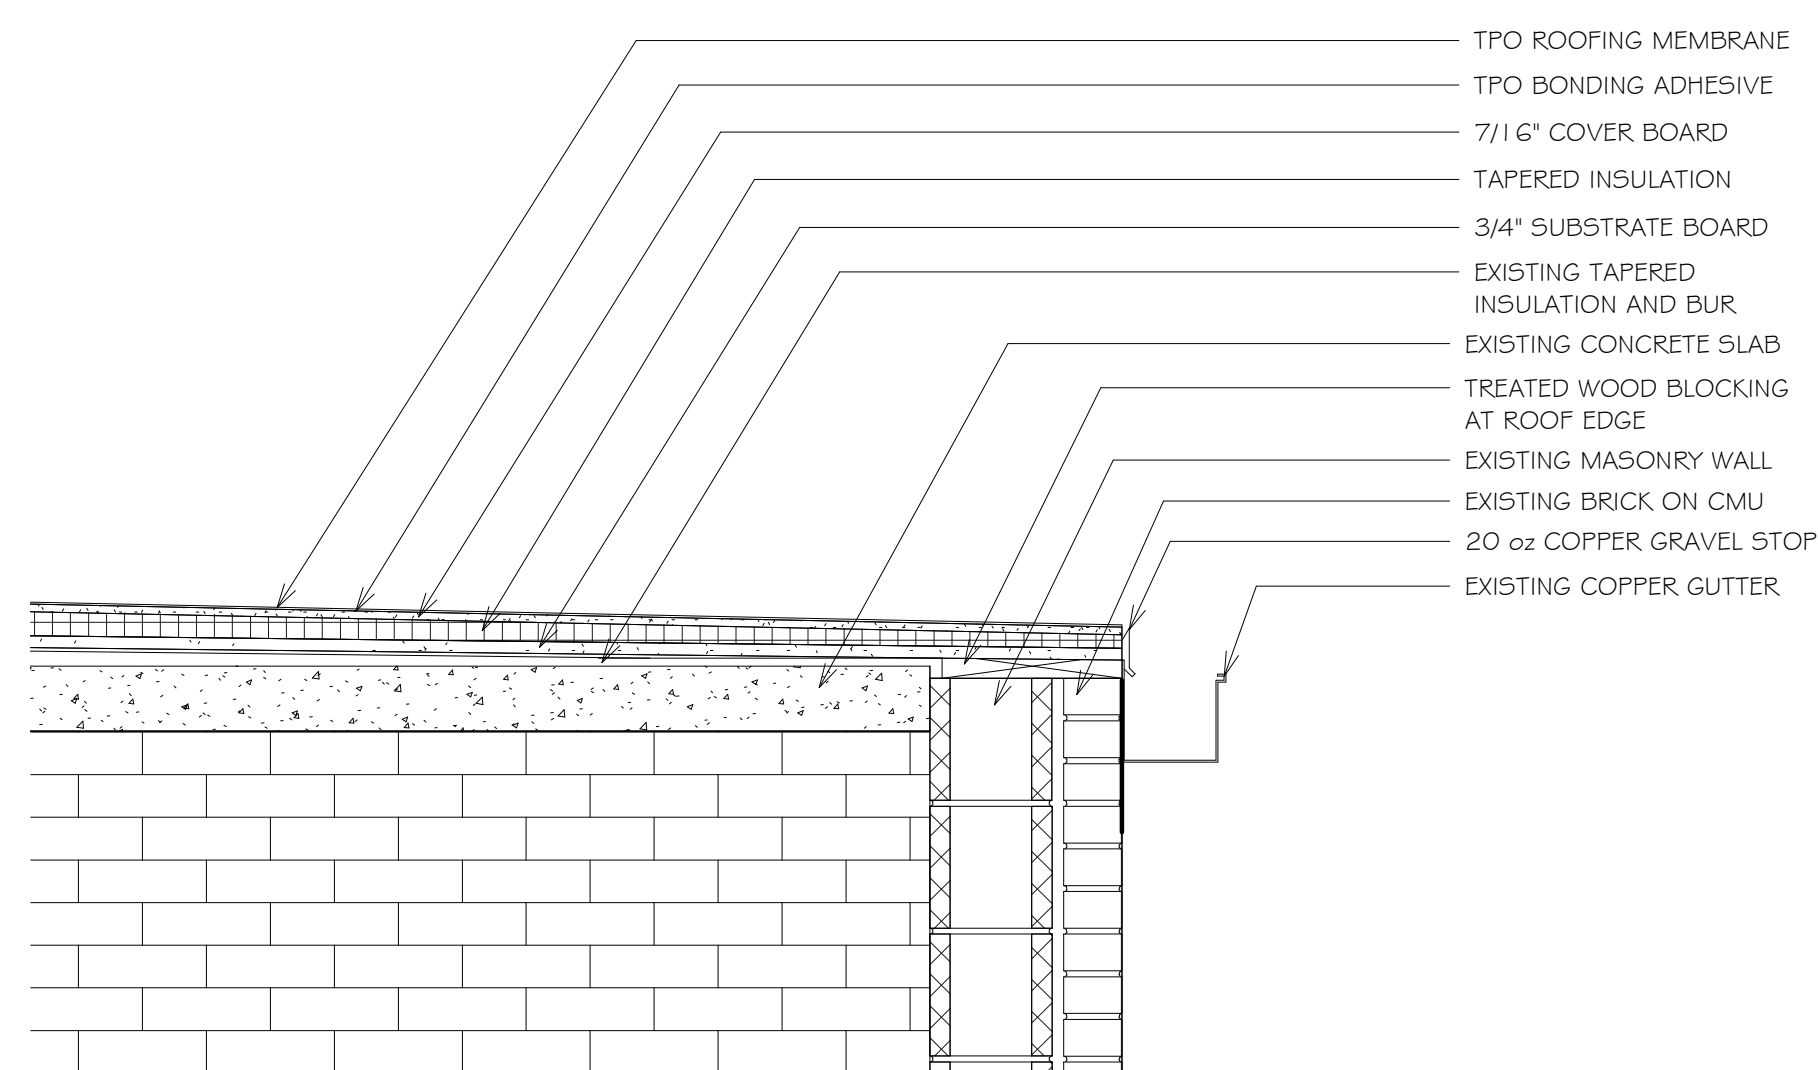


4 GUTTER DETAIL
1" = 1'-0"

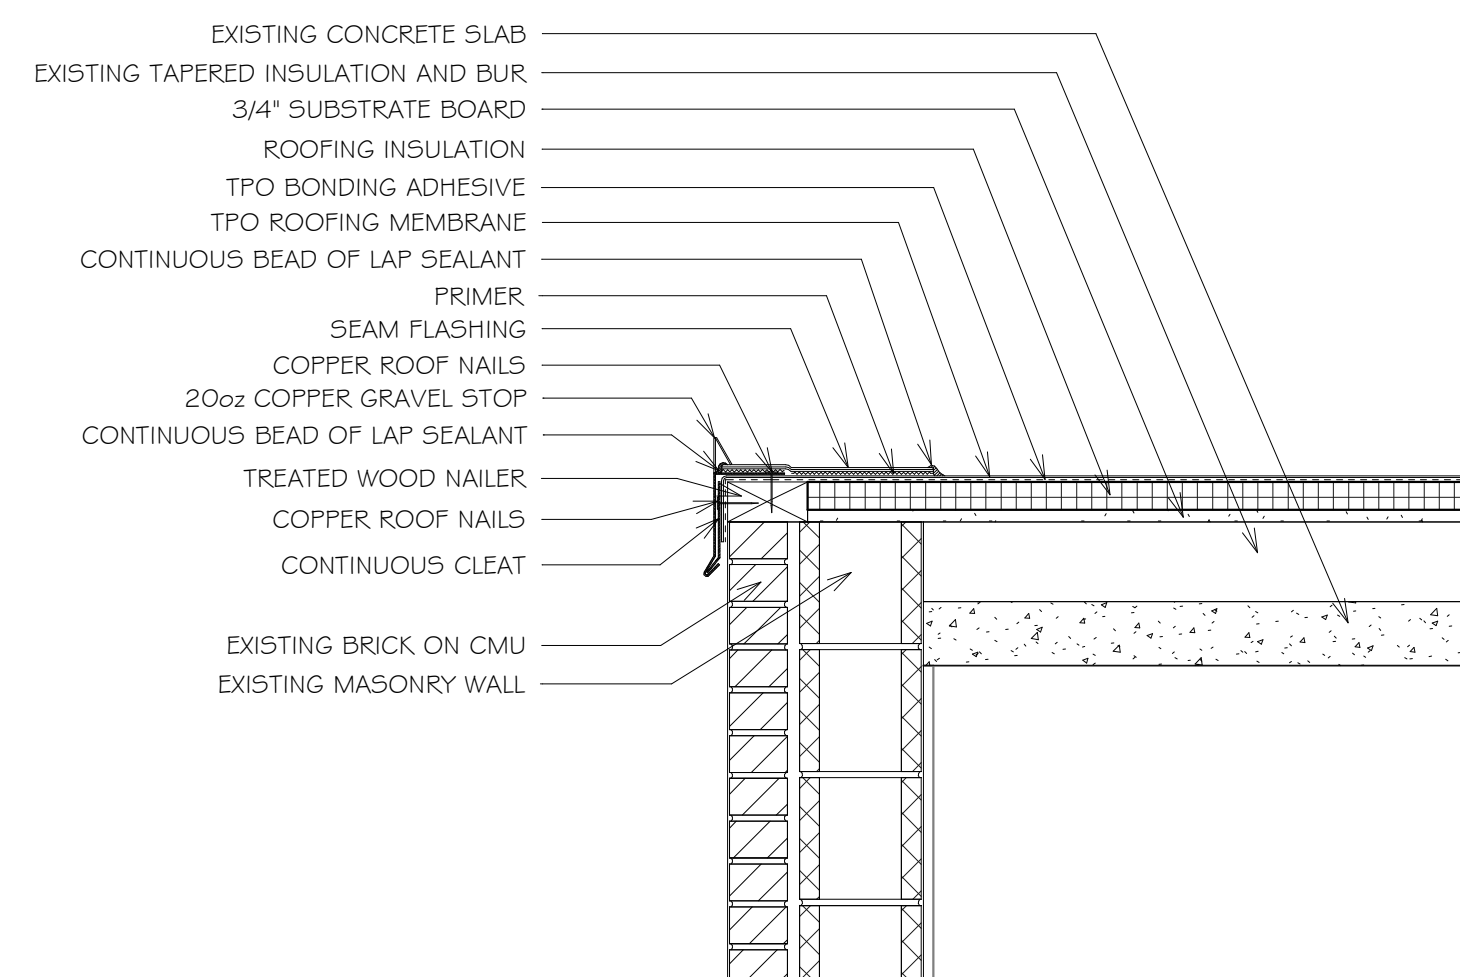


5 EDGE DETAIL
1" = 1'-0"

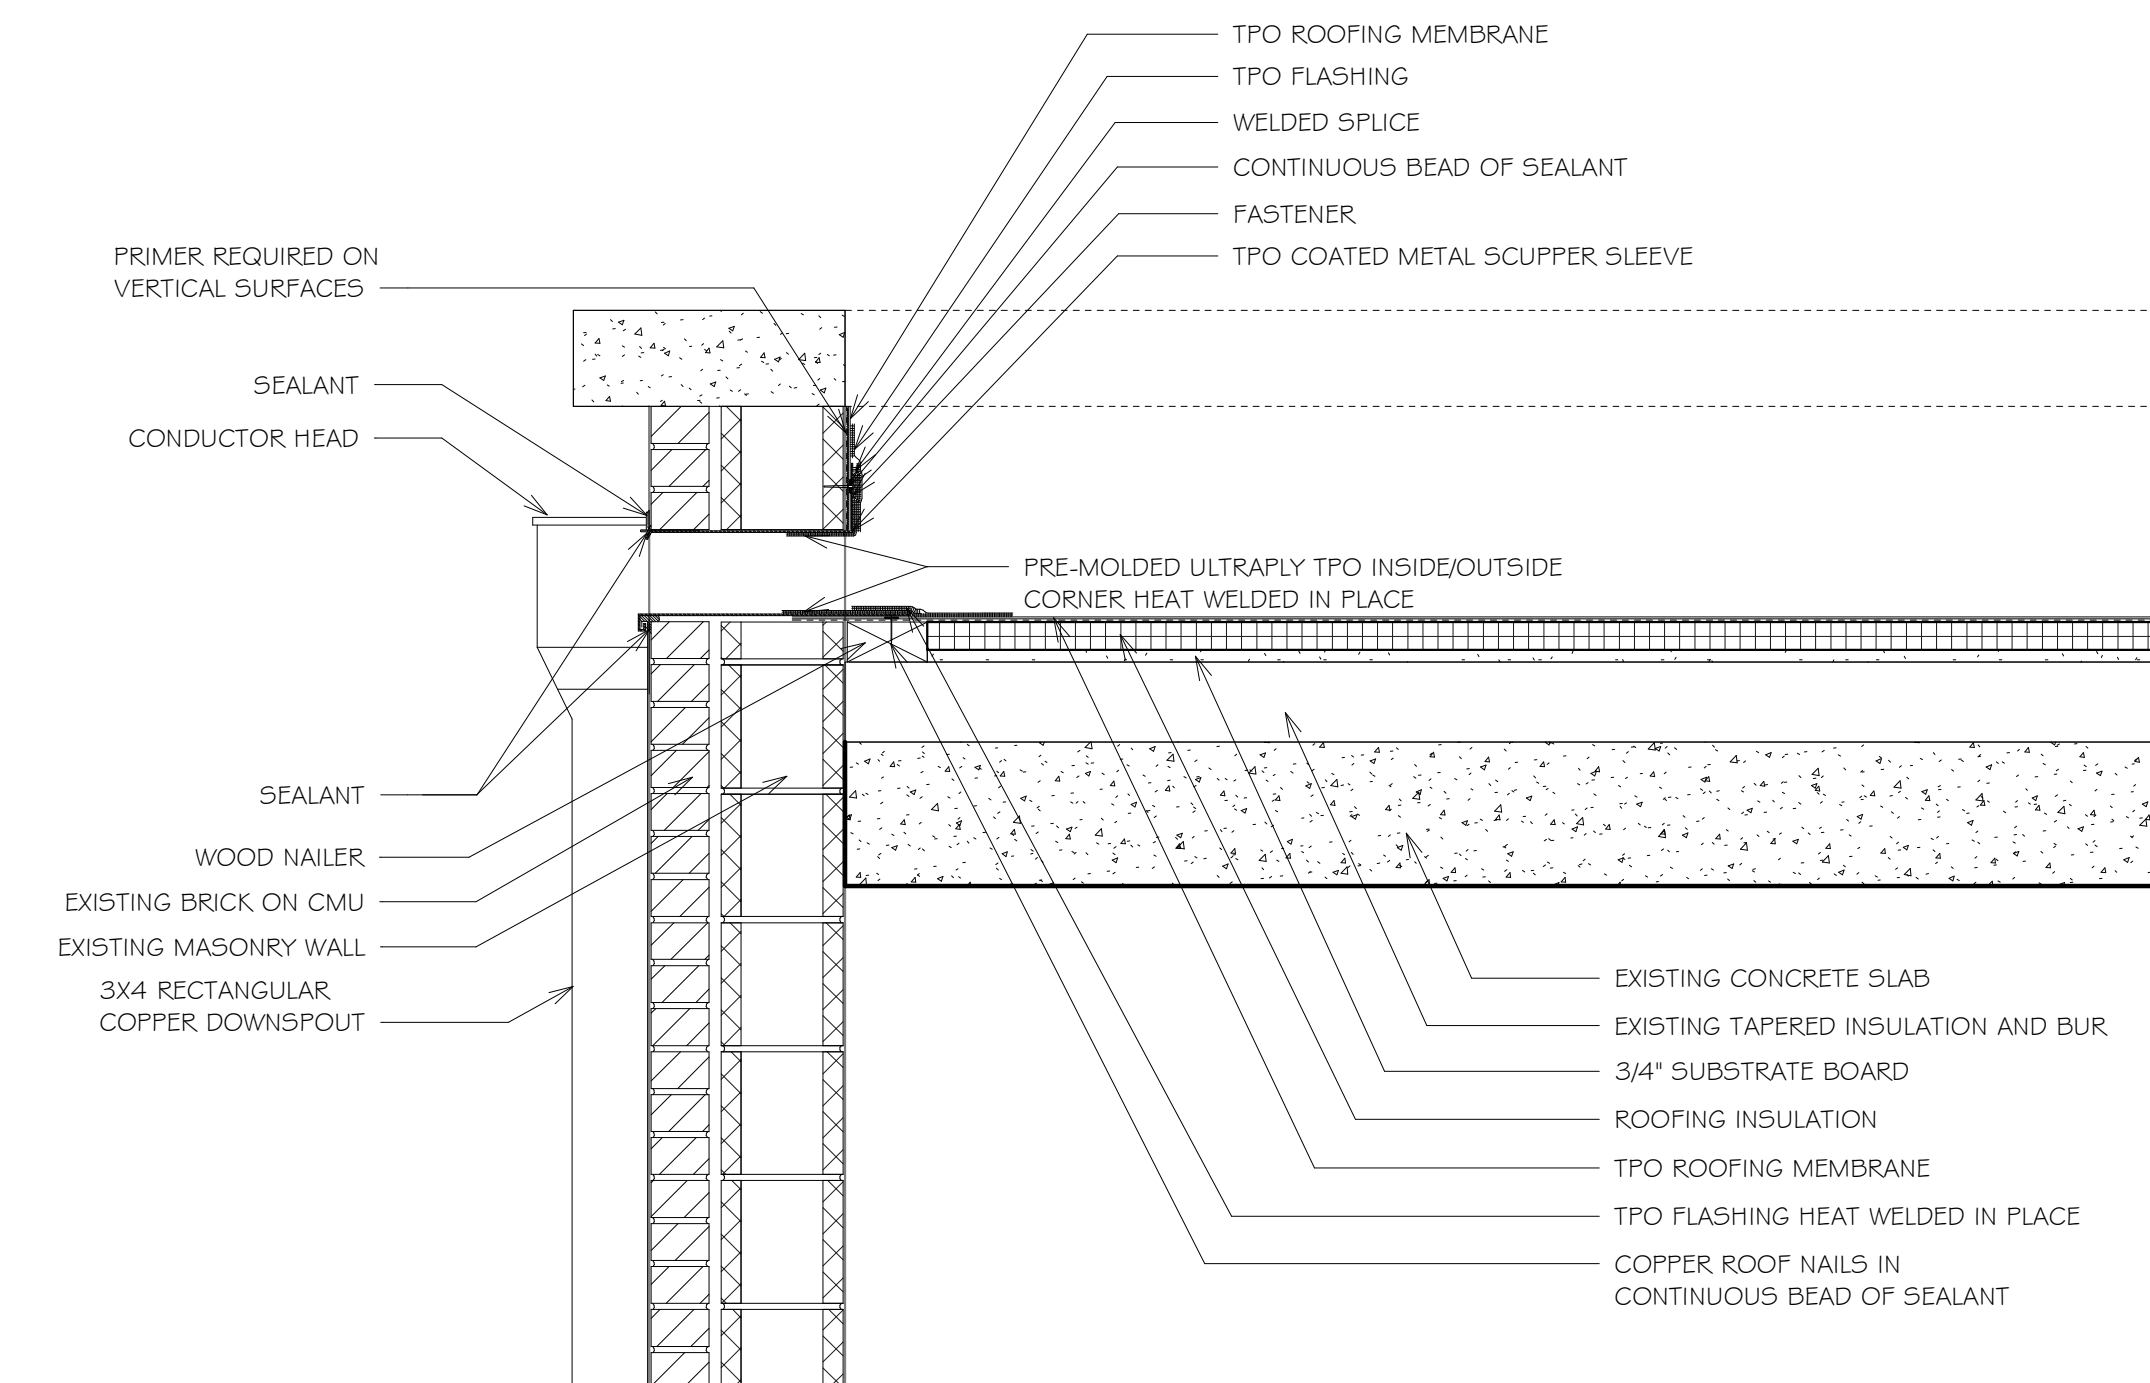

6 SCUPPER SECTION DETAIL
1" = 1'-0"

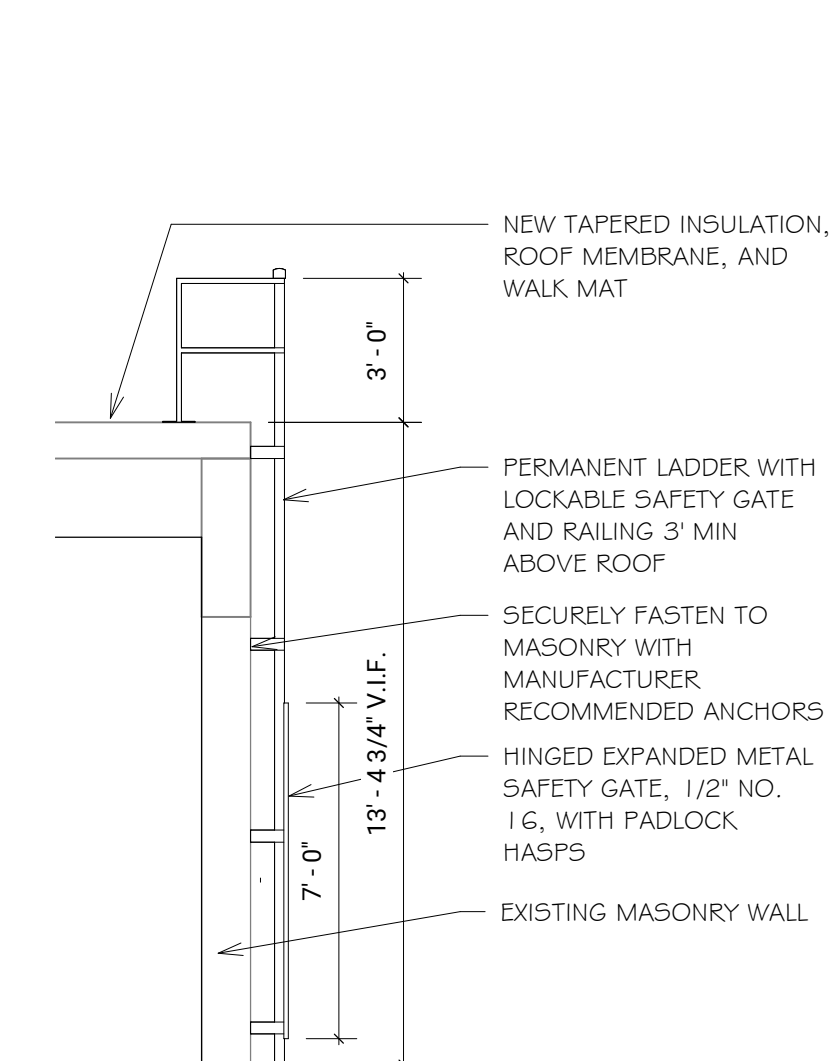

7 LADDER DETAIL
1/4" = 1'-0"

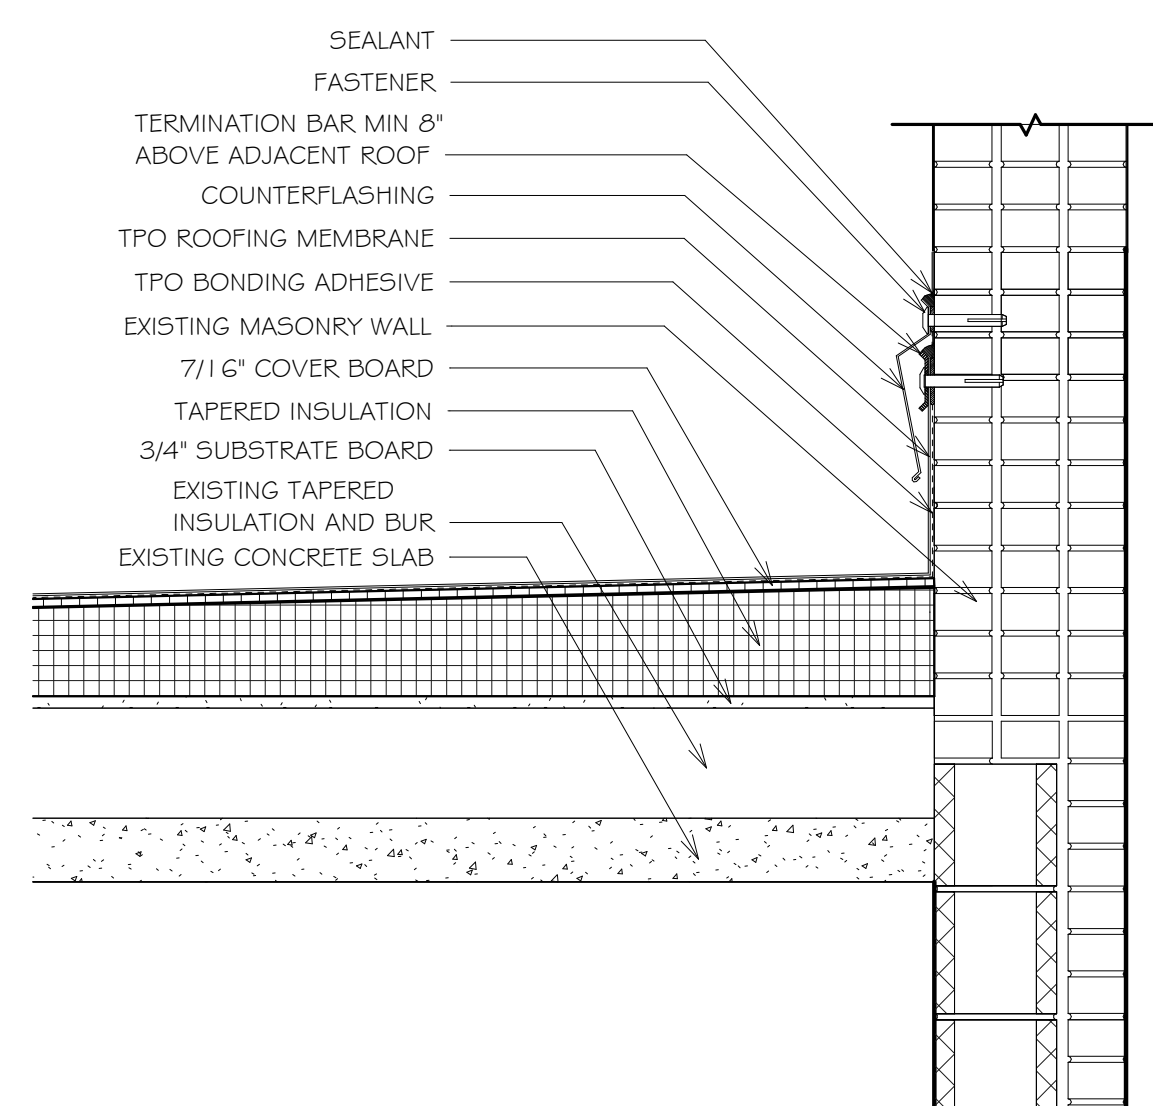

8 TYP WALL FLASHING DETAIL
1" = 1'-0"



DRAWN BY / CHECKED BY
PP JR


DATE
11/4/20

PROJECT NUMBER
18009



REVISED

SHEET TITLE
ROOF DETAILS

DRAWING NUMBER
A8.1

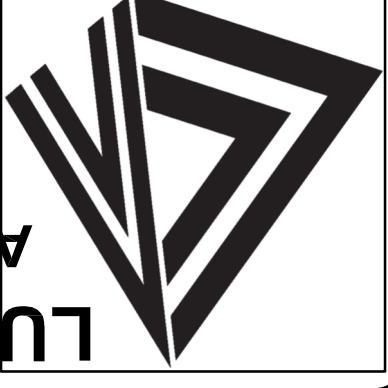


- KEY NOTES:**
 (ALL NOTES ARE TYPICAL EACH CONDENSING UNIT)
 M. C. SHALL REMOVE EXISTING CONDENSING UNIT DURING RE-ROOFING AND STORE IN A SECURE AREA. COORDINATE LOCATION WITH ARCHITECT AND OWNER.
 M. C. SHALL DISCONNECT AND EVACUATE EXISTING REFRIGERANT SUCTION AND LIQUID LINES. SALVAGED REFRIGERANT TO BE USED FOR REINSTALLATION. EXCESS REFRIGERANT TO BE TURNED OVER TO OWNER.
 M. C. SHALL REINSTALL EXISTING CONDENSING UNITS ON NEW 4x4 TREATED WOOD BLOCKS. REFER DETAIL THIS SHEET.
 M. C. SHALL CLEAN/PURGE, RECHARGE AND REINSTALL EXISTING REFRIGERANT LINES ONCE CONDENSING UNITS ARE RESET.
 M. C. SHALL CHECK FOR LEAKS AND TEST EACH HVAC SYSTEM ONCE IT IS REINSTALLED. ADVISE H. A. L. AND ARCHITECT IF ANY UNITS FAIL THIS TEST.
 M. C. SHALL PROVIDE UNIT PRICE TO REPLACE EXISTING REFRIGERANT LINES WITH NEW TYPE L COPPER LINES. NEW REFRIGERANT CHARGE AND 1/2" ARMWELX OR EQUAL INSULATION. CONTRACTOR SHALL BASE UNIT PRICE ON 75 FT OF PIPING FOR SUCTION AND LIQUID LINES.
 EXISTING PIPE CURBS TO BE REUSED. FIELD VERIFY EXACT LOCATION, AND QUANTITY.
 M. C. TO PROVIDE UNIT PRICE TO REMOVE AND REPLACE EXISTING PIPE CURB SIMILAR TO EXISTING PIPE CURBS.
 E. C. SHALL REMOVE EXISTING WIRING FROM THE DISCONNECT SWITCH PRIOR TO REMOVAL OF EXISTING CONDENSING UNIT.
 E. C. SHALL REINSTALL WIRING TO EXISTING DISCONNECT SWITCH ONCE EXISTING CONDENSING UNIT IS RESET BY M. C.
 CONTRACTOR TO FIELD VERIFY LOCATIONS OF EXISTING CONDENSING UNITS.
 ELECTRICAL CONTRACTOR TO PROVIDE UNIT PRICE TO FURNISH & INSTALL ONE (1) 15 AMP 125 VAC 175' OF WIRING & CONDUIT AND CONNECT TO CLOSEST EXISTING ELECTRICAL PANEL.
 ALL EXISTING GAS VENTS & PLUMBING VENTS THROUGH EXISTING ROOF ARE TO REMAIN (ALL ARE NOT INDICATED ON THIS PLAN)

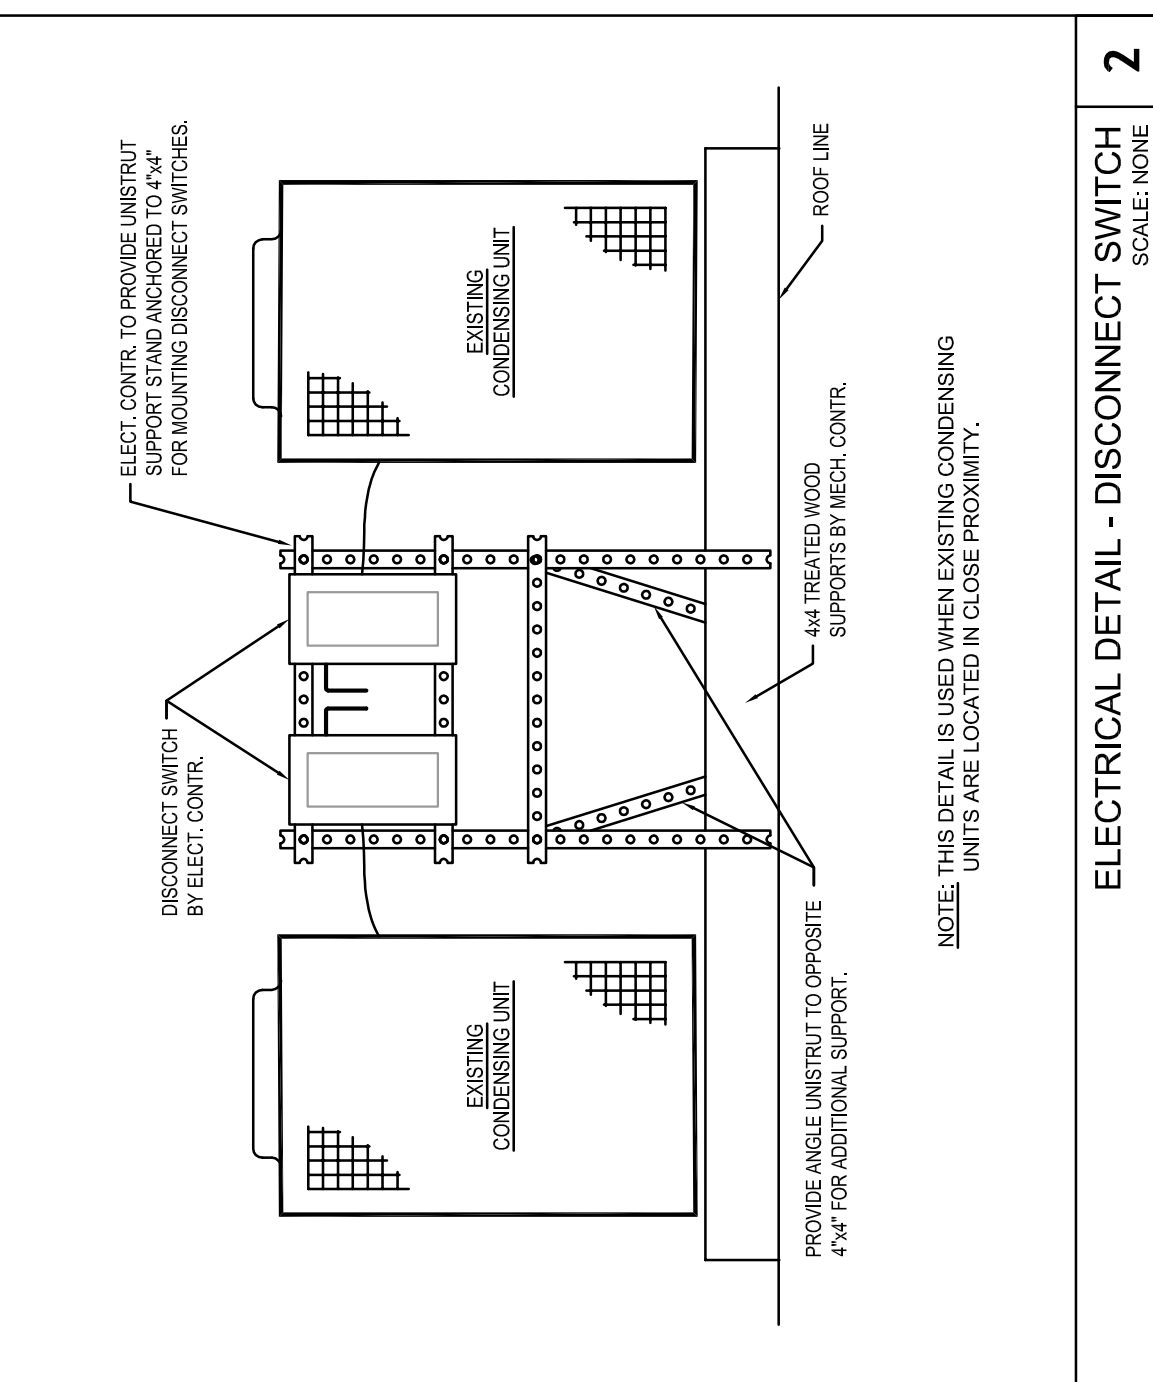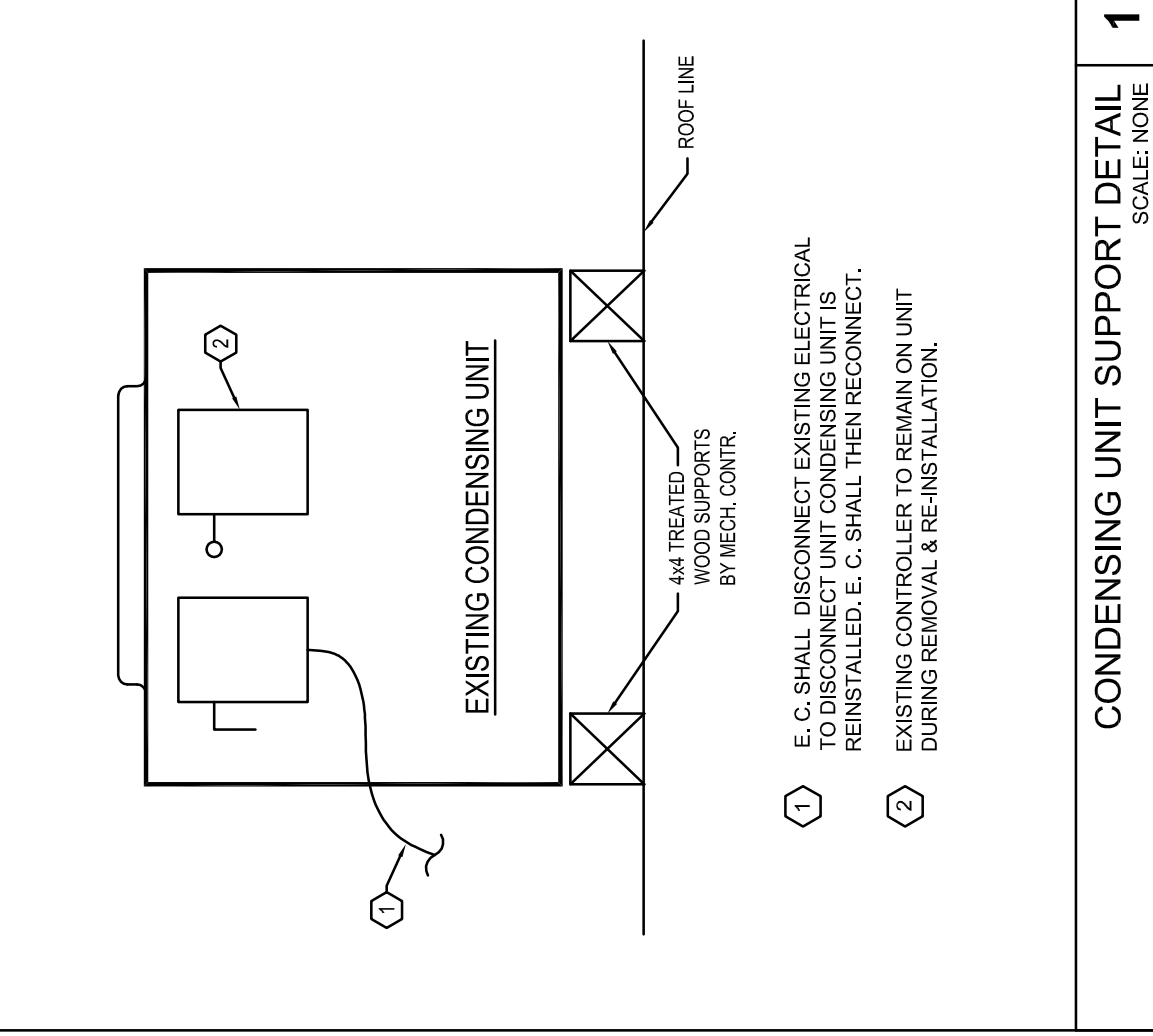


NOTE: MECHANICAL CONTRACTOR TO COORDINATE PHASING OF CONDENSING UNIT REMOVAL & REINSTALLATION WITH THE ROOFING CONTRACTORS BIDDING THE PROJECT. PRIOR TO BIDDING.

NOTE: ALL CONDENSING UNITS, REFRIGERANT LINES, ELECTRICAL CONDUITS, WIRING & DISCONNECTS, ON EXISTING ROOF TO BE REMOVED. ALL DISCONNECTS TO COMPLETE BACK TO A POINT BELOW THE SECOND FLOOR CEILING. THESE CONDENSING UNITS ARE TO BE DISPOSED OF BY THE MECHANICAL CONTRACTOR.

NOTE: EXISTING PIPE CURBS ON THIS ROOF (USED FOR EXISTING CONDENSING UNITS) ARE TO BE REMOVED. MECHANICAL CONTRACTOR TO FOAM SEAL ALL REMAINING CURB OPENINGS WATER TIGHT. FIELD VERIFY LOCATIONS OF ALL PIPE CURBS.

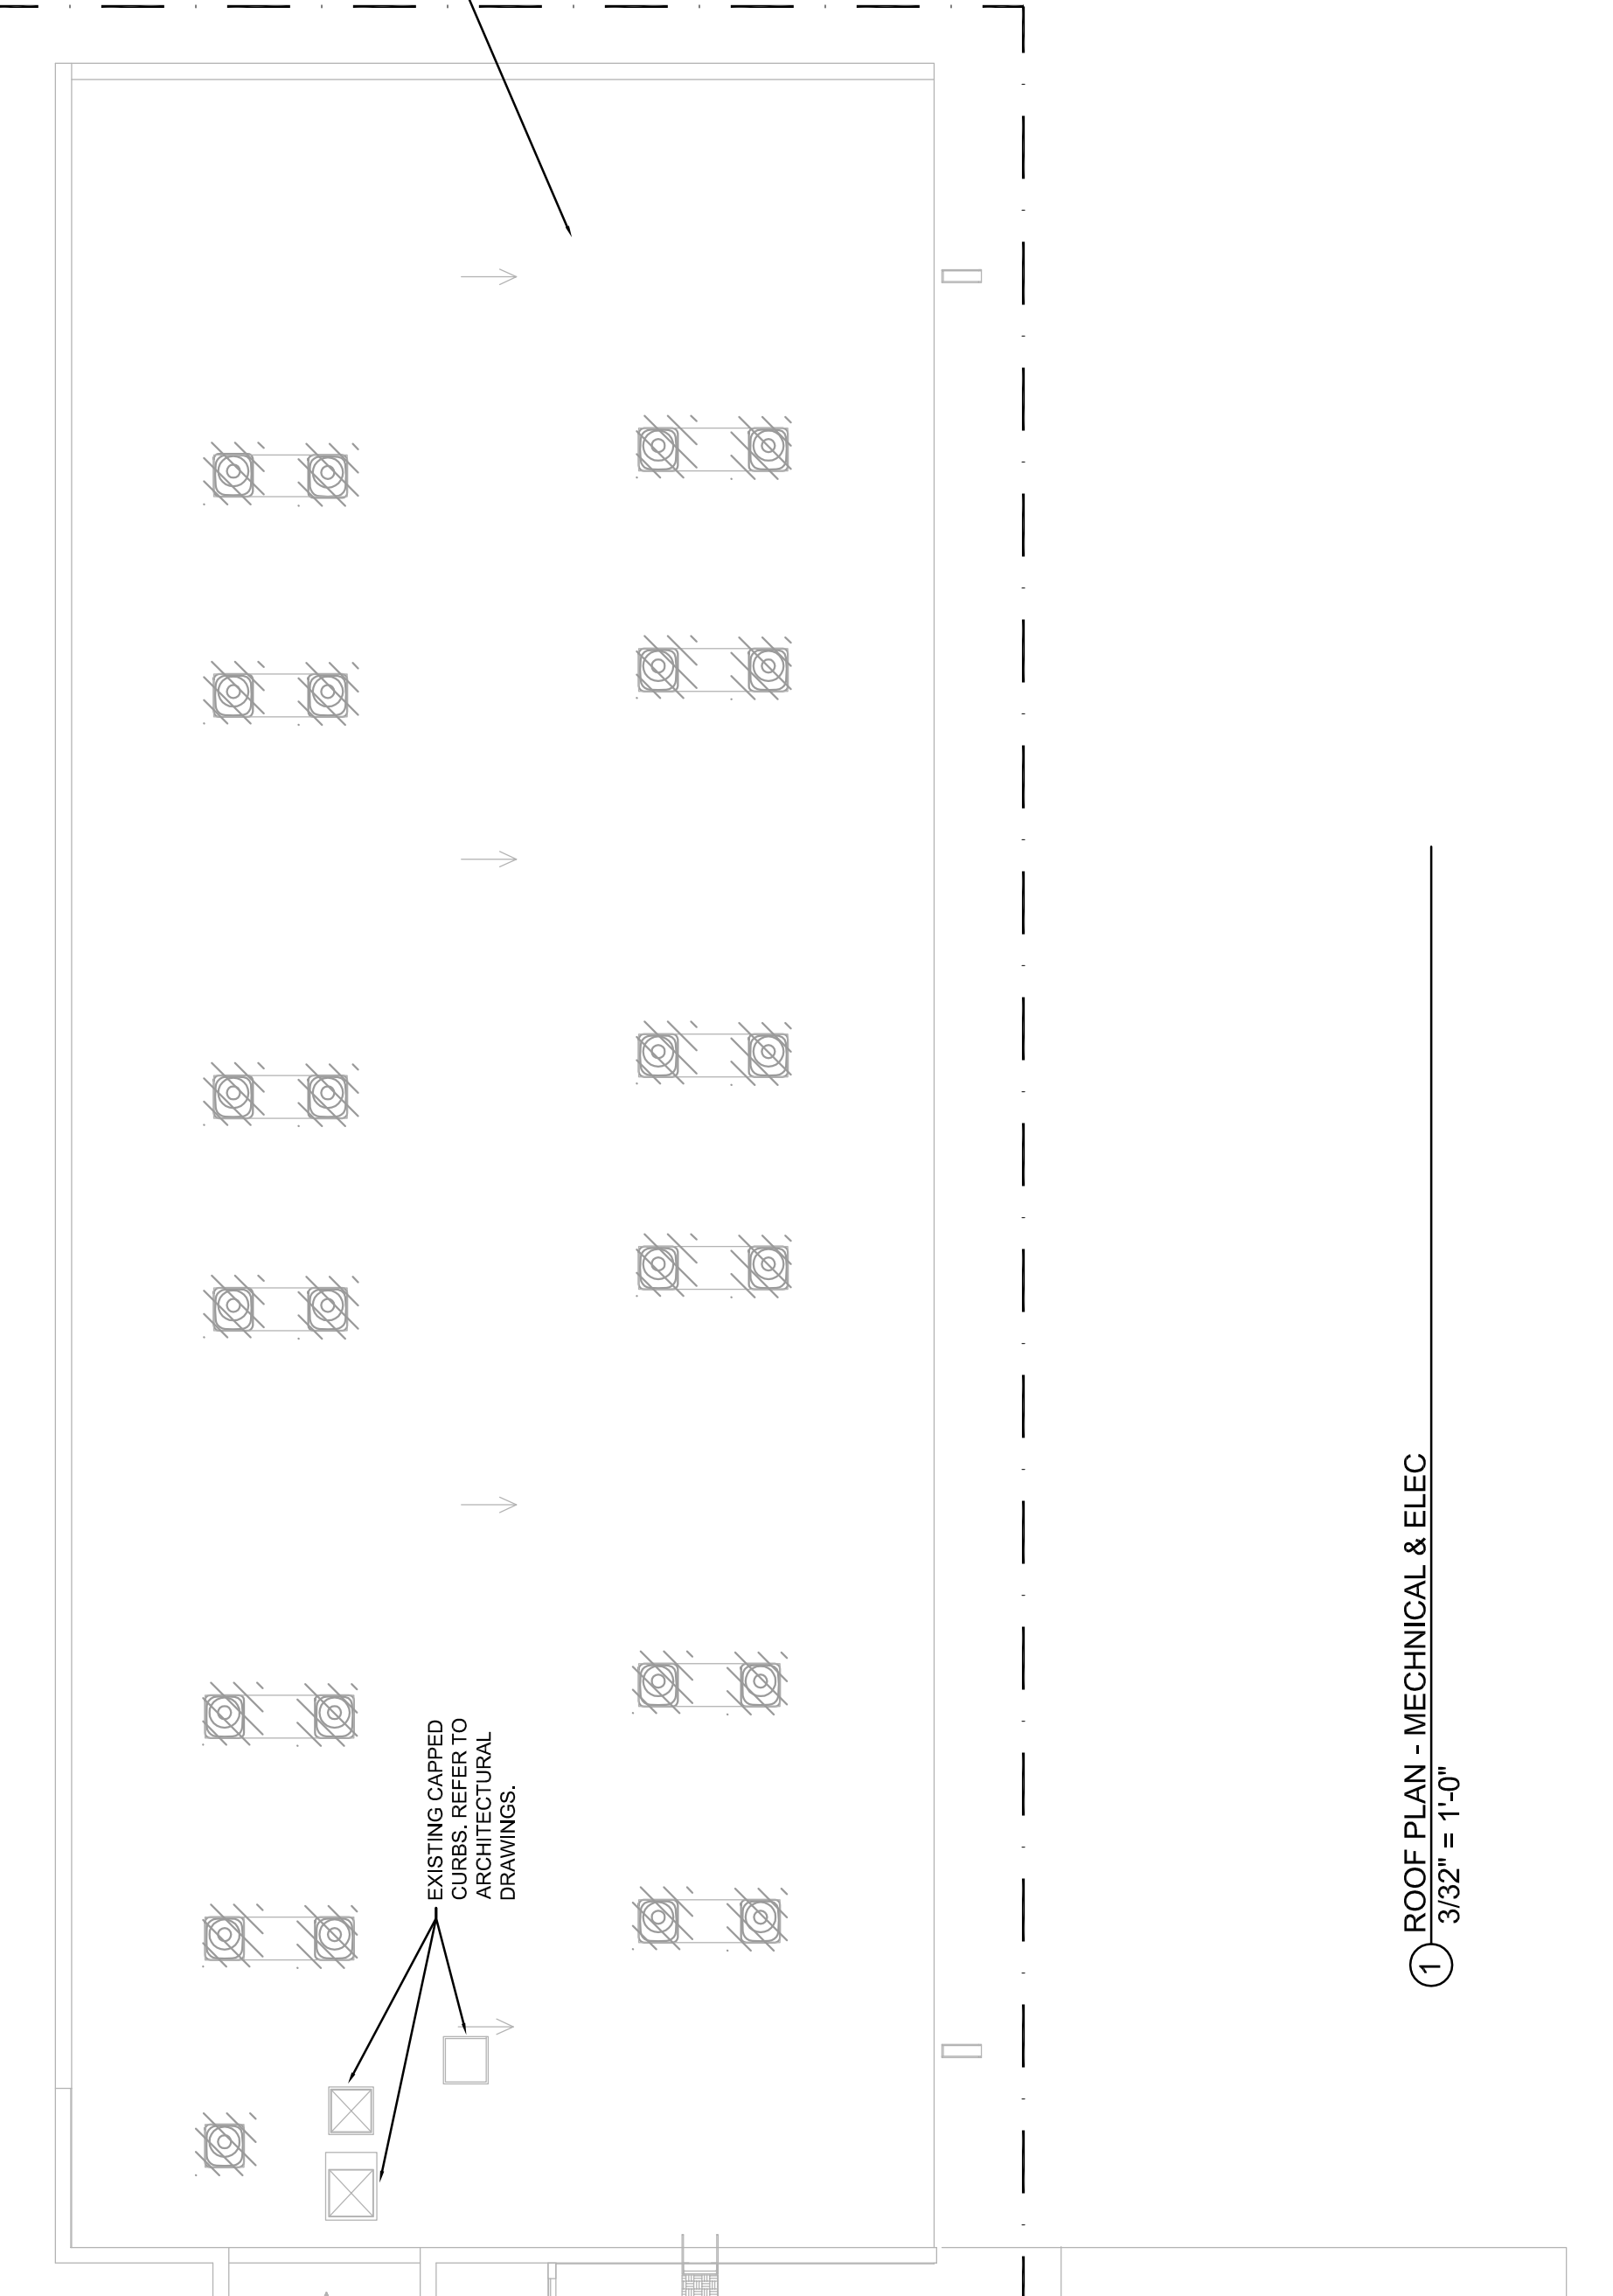

1 ROOF PLAN - MECHANICAL & ELEC
 3/32" = 1'-0"

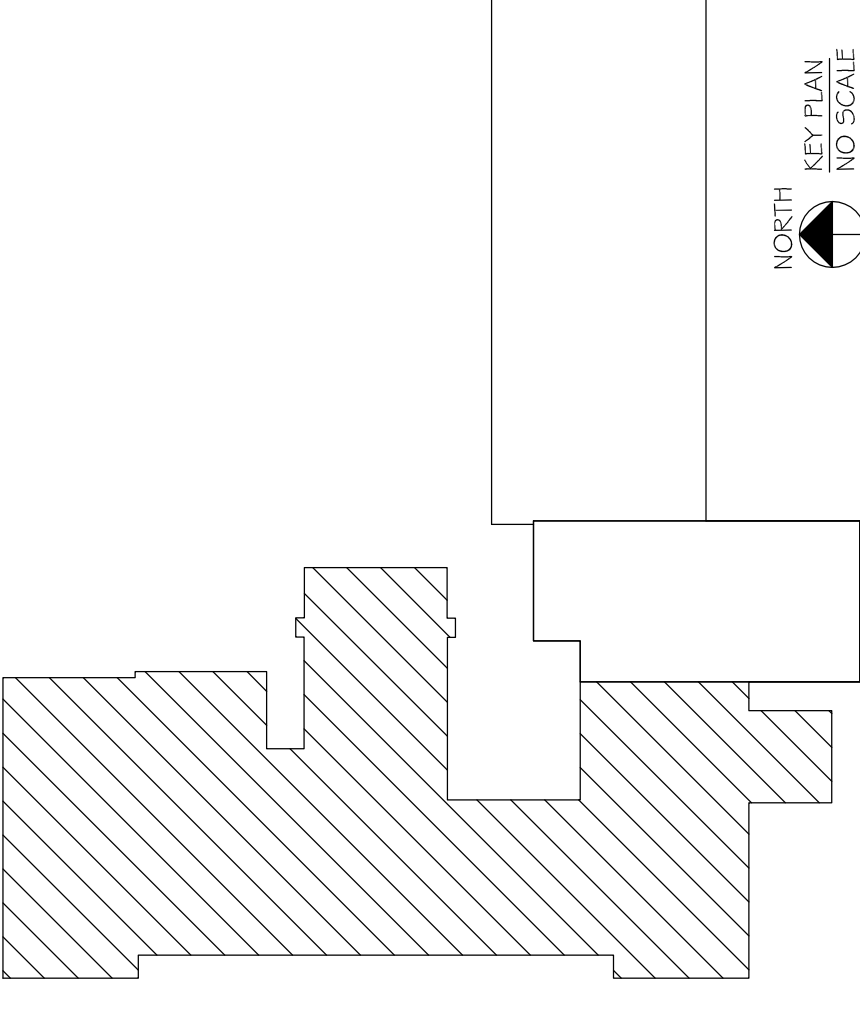

NORTH
 KEY PLAN
 NO SCALE

